



CONTACT: TIM FEDDER (ON SITE) 804-366-5023
 DANIEL CRAWLEY (ELECTRICIAN) 434-444-2238

SPLICE INTO EXISTING 3 PHASE PRIMARY
 AT CORNER OF LAMBS LN


BORE UNDER LAMBS LN TO NEW PROPERTY

PULL NEW 3 PHASE THROUGH CUSTOMER INSTALLED
 6" CND TO NEW TX SITE. AND THEN BACK TO
 SPLICE PIT.

WL 2
F2327 UK84
INSTALL:
 TD3575048L

WL 1
F2327 UK02
INSTALL:
 KLOCCBL
 ISOLAT3PH3PH
 KTUNNEL6 (100')
 CND6SPOOL (100')
 KCND6TUNNEL (100')
 KCBLCND1 (300')
 U310J3SP (800')
 U310J3SP (800')
 KCBLCND1 (4,800')
 LABUGLN (8)

Ground Rods: _____
 Ohms: _____

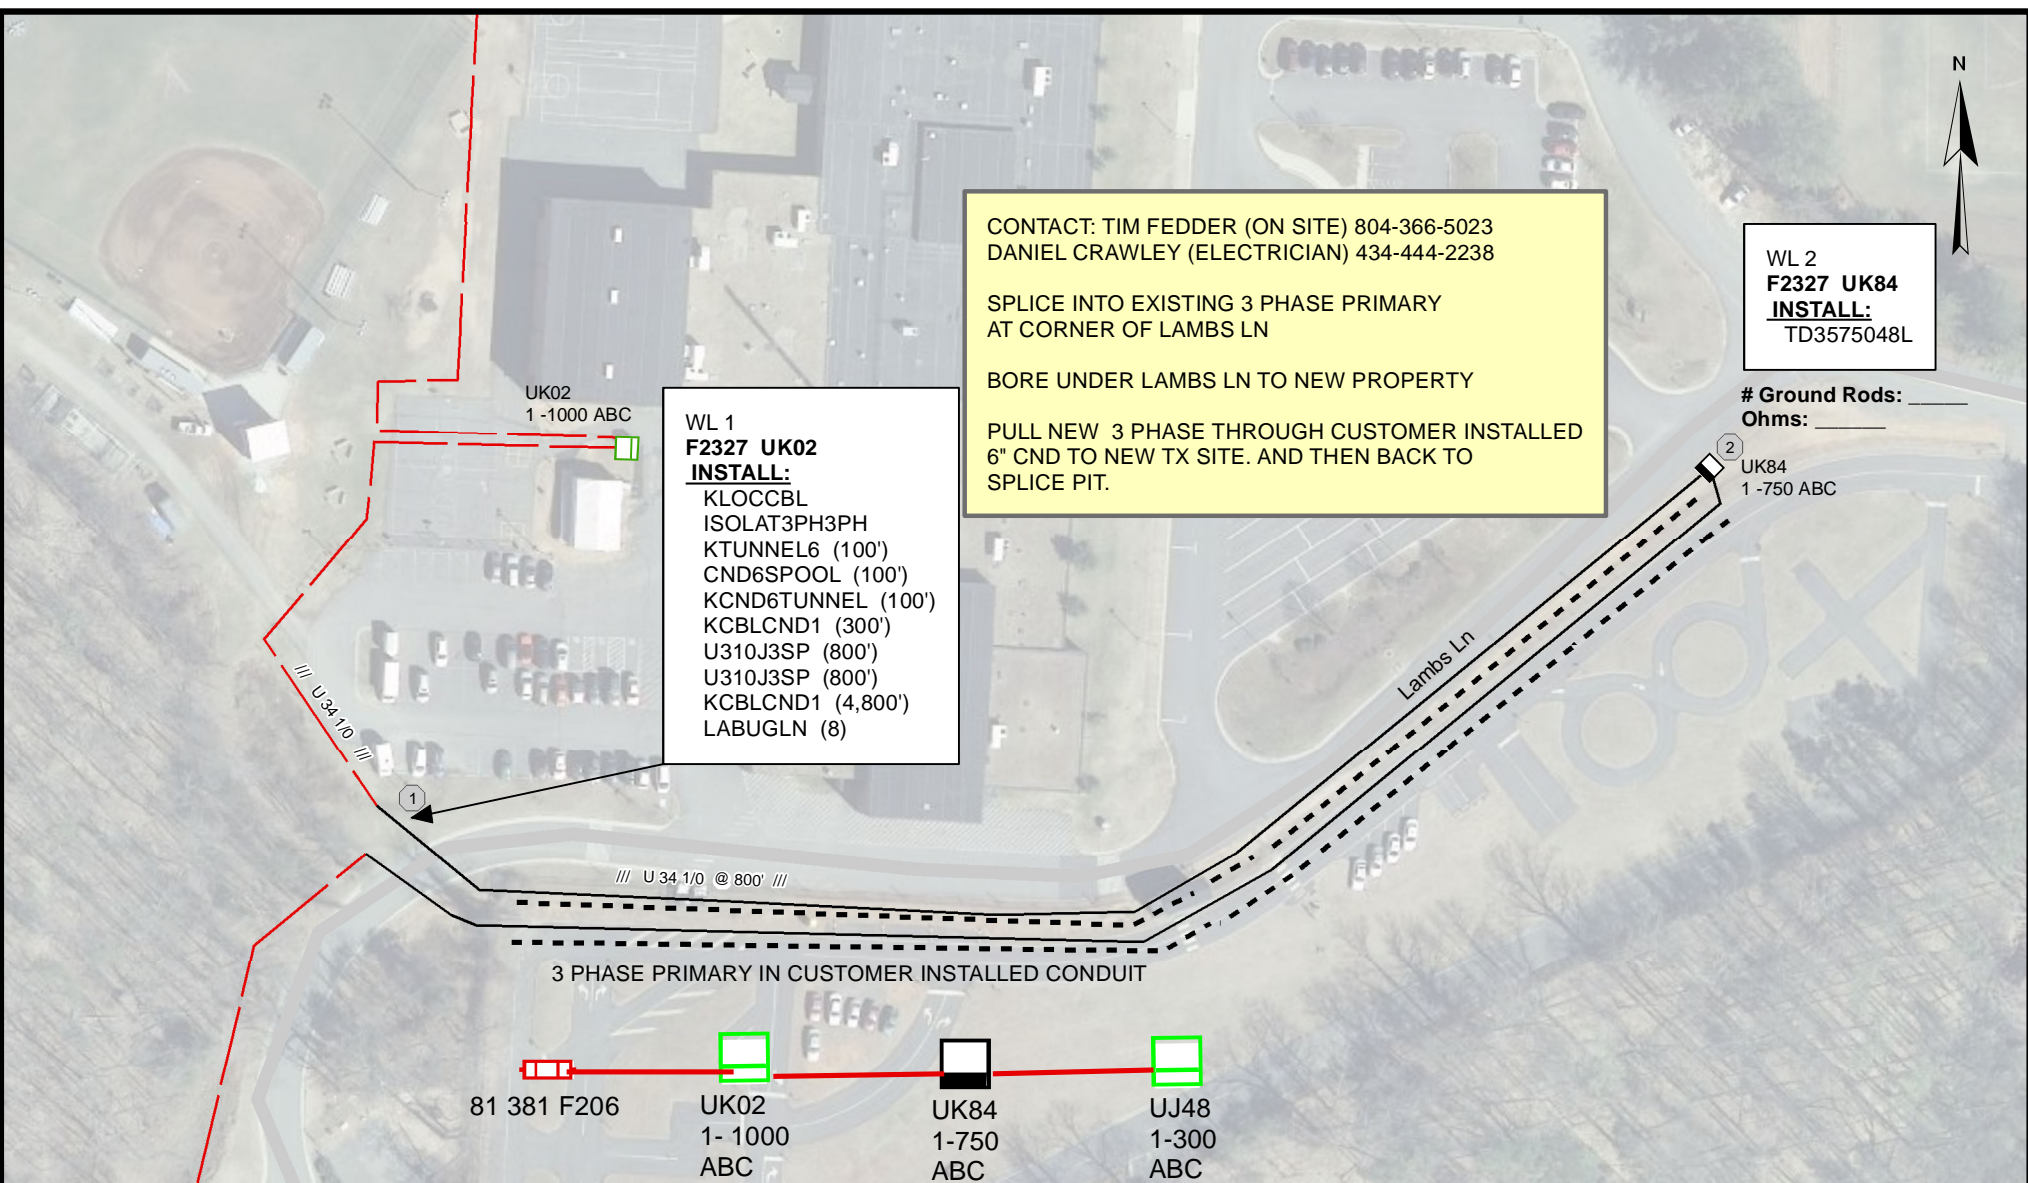

81 381 F206 UK02 UK84 UJ48
 1- 1000 1-750 1-300
 ABC ABC ABC

Volts 120/240	Amps 2000	Phase ABC	Co. Grid # F2327	Scale 1 inch = 100 feet
Voltage Drop <1%	Flicker N/A	Circuit # 81 381	Substation HOLLYMEAD	
Fault Current 36255	Est. Demand 518 KVA	Tax District 30510	Miss U # N/A	
Easement # N/A	TRS # 81 381 F206	WR Name BOYS & GIRLS CLUB OF		
POC Lindsey C Reininger	Phone # 434-260-2461	COMMERCIAL NEW UNDERGROUND		
Designer LINDS37	Phone # N/A			
Work Request # 10479529	Date 12/15/2021	Location 195 LAMBS LN CHARLOTTESVILLE VA		